



WMF Undermachine cooler for 9000S+ planning information

(with integrated grounds container)

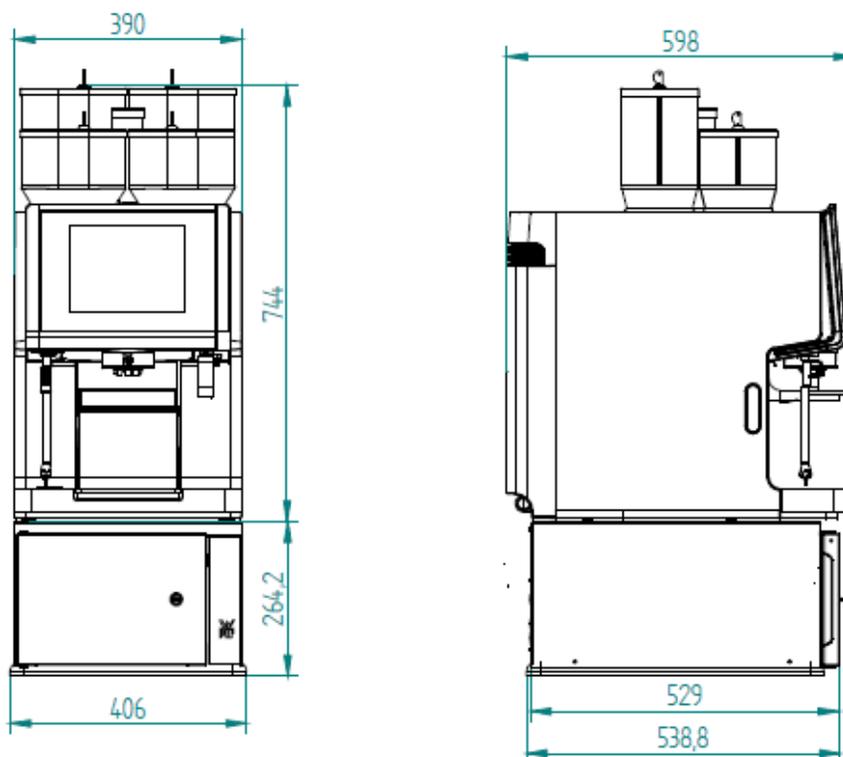


Optional:
 Area for lines and hoses (water, waste water, power) for counter cut out connection.
 For 3kW minimum Ø50
 For 6.5kW minimum Ø 70

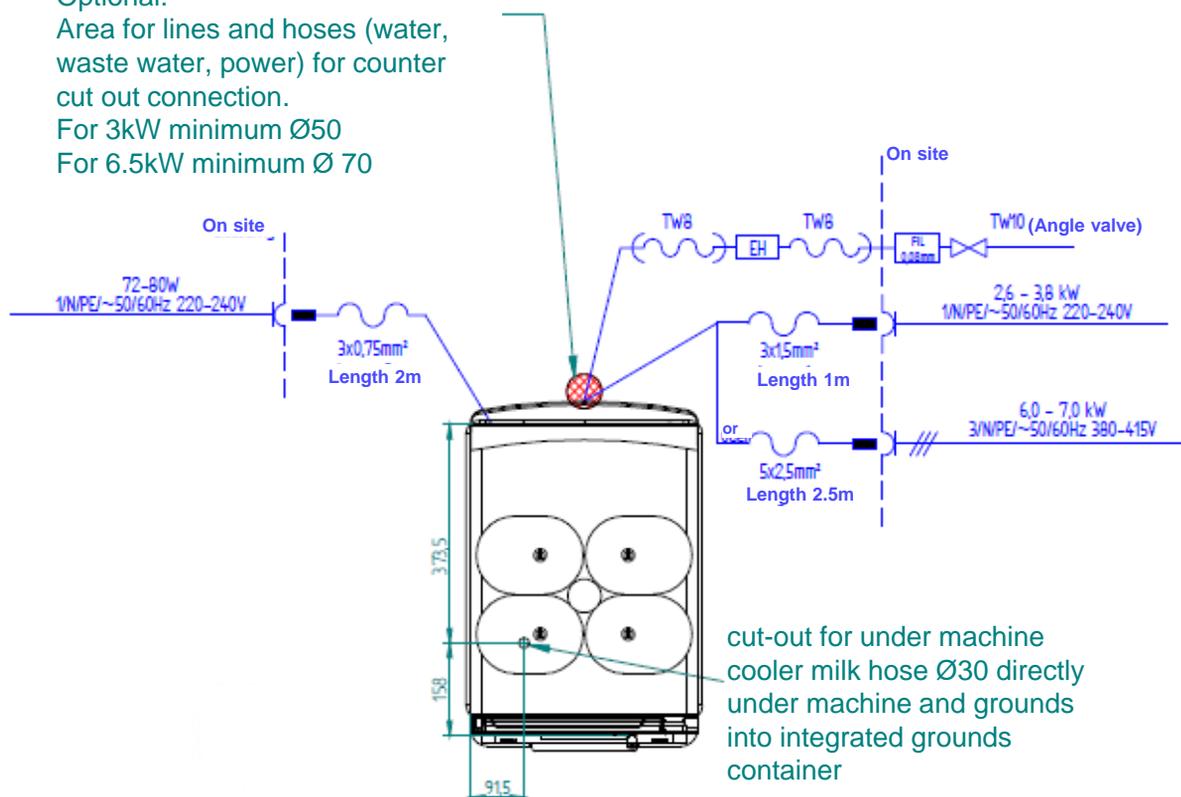

WMF Undermachine cooler for 9000S+ planning information


(with integrated grounds container)

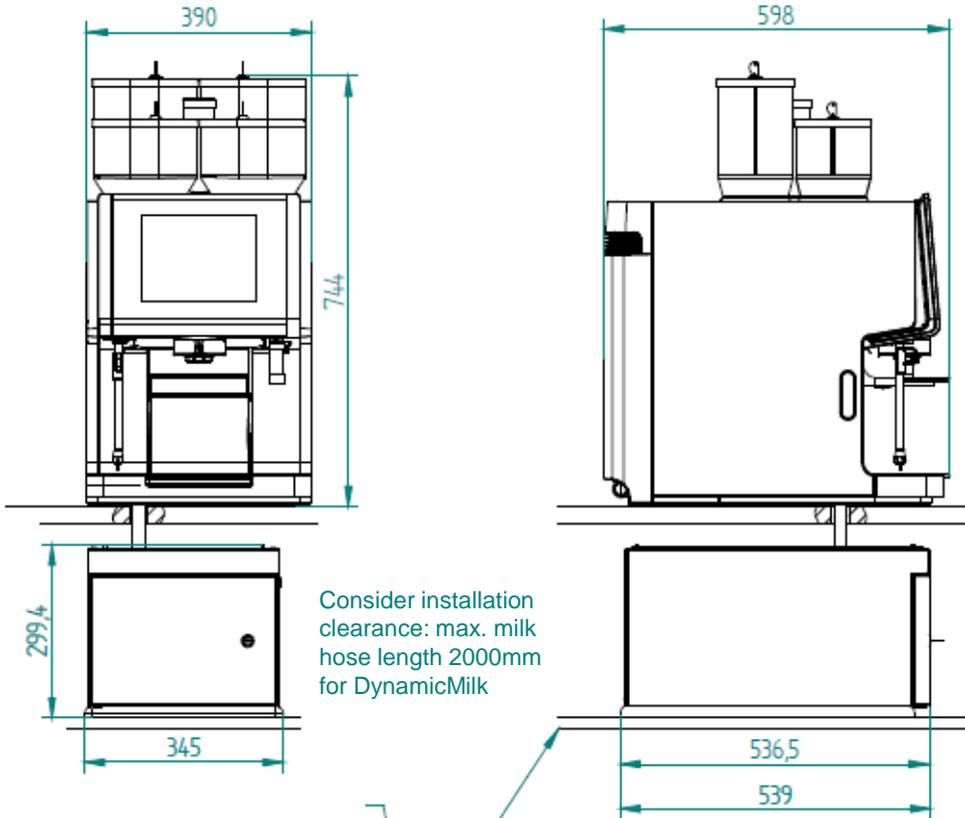

Consider installation clearance: max. milk hose length 2000mm for DynamicMilk

Footprint for cooler

Optional:
 Area for lines and hoses (water, waste water, power) for counter cut out connection.
 For 3kW minimum Ø50
 For 6.5kW minimum Ø70
 Placement in hatched area is freely selectable

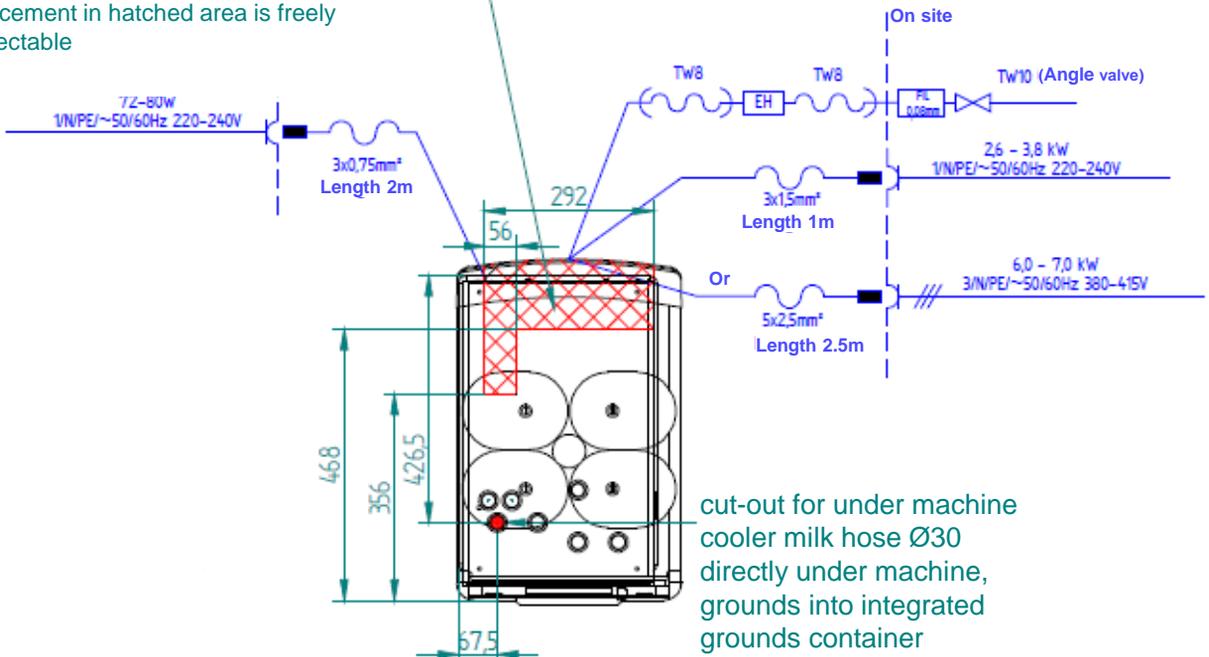


cut-out for under machine cooler milk hose Ø30 directly under machine, grounds into integrated grounds container


WMF Undermachine cooler for 9000S+ planning information

(grounds through counter into container)

Depending on the width of the grounds container the space required for the cooler on the left side need to be considered

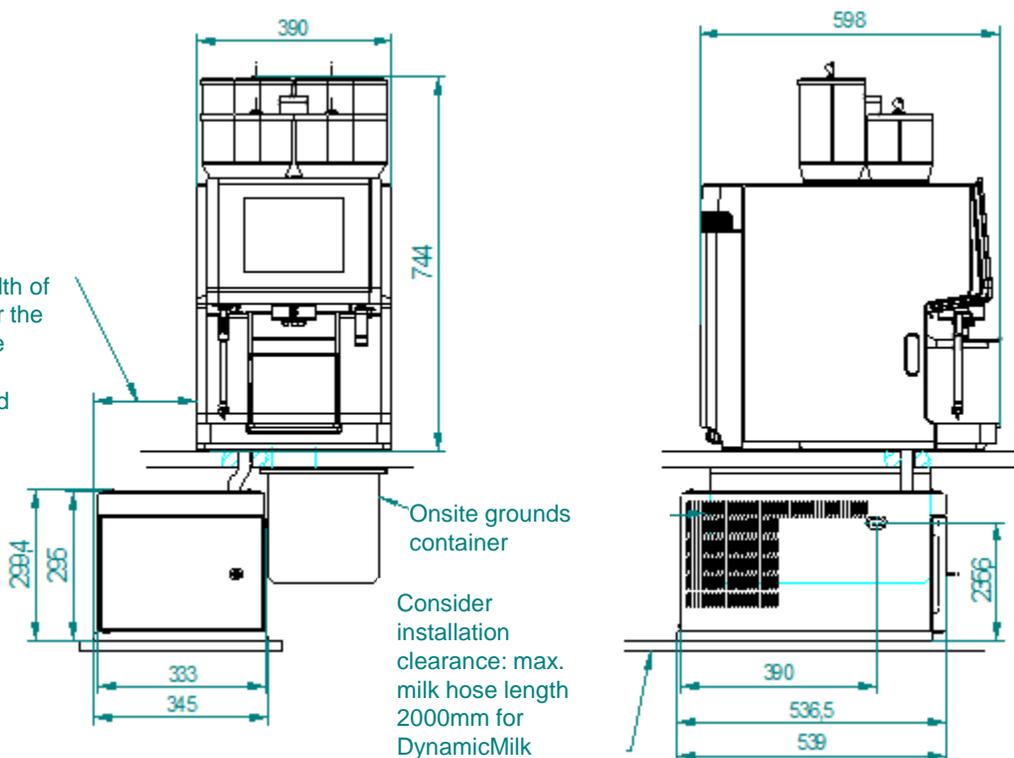

Optional:
 Area for lines and hoses (water, waste water, power) for counter cut out connection.
 For 3kW minimum Ø50
 For 6.5kW minimum Ø70
 Placement in hatched area is freely selectable

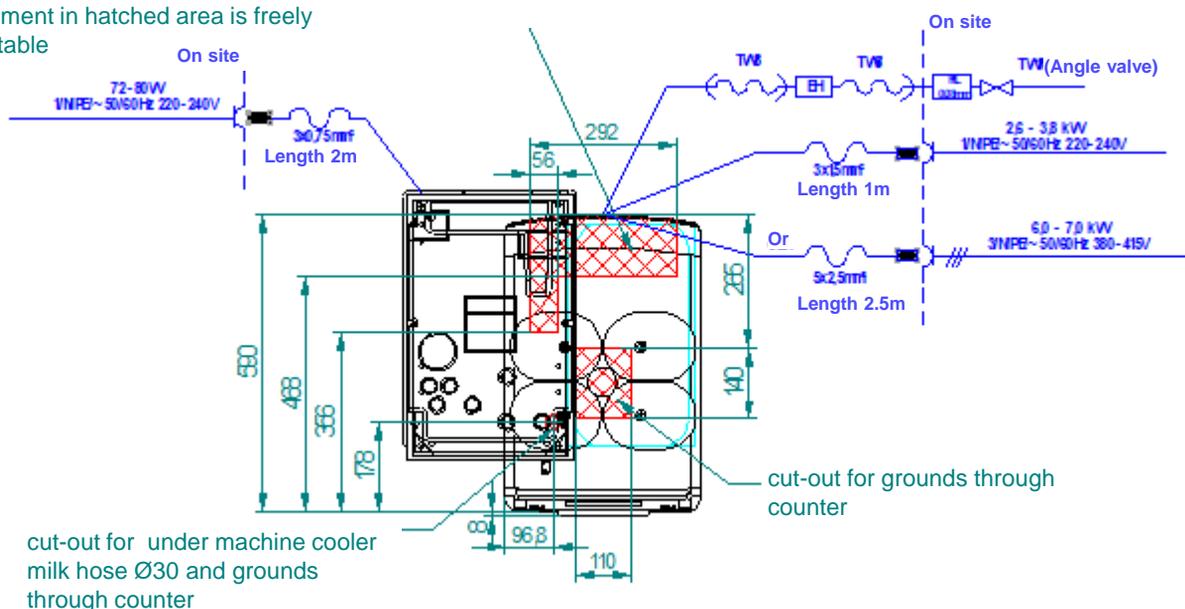

WMF Undermachine cooler for 9000S+ planning information

Conditions for usage and installation

Any necessary on-site preparatory work for electricity, water and drainage connections at the customer's premises is to be arranged by the machine owner / operator. The work must be carried out by authorised installation technicians in compliance with general, country-specific and local regulations. The WMF service engineers may only connect the coffee machine to existing prepared connection points. WMF Service is neither authorised nor responsible for carrying out any on-site installation work prior to connection. In order to avoid possible faults from arising on our shielded data lines due to potential equalisation currents between the devices, an additional potential equalisation unit should be planned for devices connected to the vending system.

Dimensions and empty weight	<u>Under Machine cooler</u>	Width 406 mm Height 265 mm Depth 539 mm Weight Approx. 26 kg Capacity 9,5 l
	<u>Under counter cooler</u>	Width 345 mm Height 300 mm Depth 539 mm Weight Approx. 22 kg Capacity 9,5 l
Coolant		R600a (GWP3), Category N/4 (CFC free)
	Amount of coolant	11 g
	Power supply	220–240 V 50 / 60 Hz (1 / N / PE) The unit does not need to be set to 50 or 60 Hz. The unit automatically switches to 50 Hz or 60 Hz
	Plug	Low temperature plug
	On-site power connection	3 x 1,5 mm ²
	Rated current	0.29 A–0.31 A
	On-site fuses	Max 16 A
	Degree of protection	IP X0
Installation Clearance	For operating, service and safety reasons the machine should be installed with a clearance of not less than 50 mm at the back and sides from the building or non-WMF components. If possible, there should be a clearance of 50 mm to the sides. Lateral connection WMF coffee machine and WMF cooler not taken into account.	

WMF Undermachine cooler for 9000S+ planning information

Ventilation	If the possibility of ventilation is limited, adequate ventilation must be provided. Ventilation must be designed according to the installation situation. (e.g. device on legs, active ventilation, additional air vents / openings in counter area, etc.). Ventilation openings must not be covered.	
Installation surface / water spray	The device must be placed and levelled, flat, and sturdy surface. The unit is not intended to be located on a surface that is sprayed or cleaned with a water hose, steam jets, steam cleaner, or similar devices	
Electrical connection	These specifications for the electrical connection and the standards quoted apply for connecting the coffee machine in EU countries. It may be necessary to also observe additional country-specific regulations. Outside the EU countries acceptance of the standards quoted is to be checked by the legal entity or natural person who wishes to use the coffee machine. The local power supply must be constructed according to the currently valid IEC 364 (DIN VDE 0100). An isolated ground socket or a country-specific single-phase socket for single-phase connection, or a 5-pole CEE / CEKON socket per EN 60309 or a country-specific multi-pole socket for a three-phase connection, must be available near the machine. The sockets are part of the customer's on-site installation. The mains cable must not come into contact with hot surfaces. If the mains cable for this device is damaged then it must be replaced by our service personnel or a similarly qualified person, in order to prevent hazards.	
Miscellaneous	Ambient temperature	Climate class N = +16 °C to maximum +32 °C
	Maximum humidity	80 % relative humidity without condensation. Do not use device outdoors.
	Continuous sound pressure level (Lpa)	< 70 dB(A)

For more information as the instruction manual , safety data sheets and certificates , see:
<https://coffeconnect2.wmf.com>

All information refers to coffee machines/ equipment as standard version. Individual solutions can differ from the standard version.